



NUMBER
SD400-2



AIR CONTROL

EFFECTIVE: APRIL 1, 1963
Supersedes: SD400-2 dated 1/15/62

PURPOSE

The Taco Air Control continuously removes excess air from large hydronic heating and cooling systems.


For	
Job	
Date Submitted	
By	
Date Approved	
By	
<u>Location</u>	<u>Size</u>

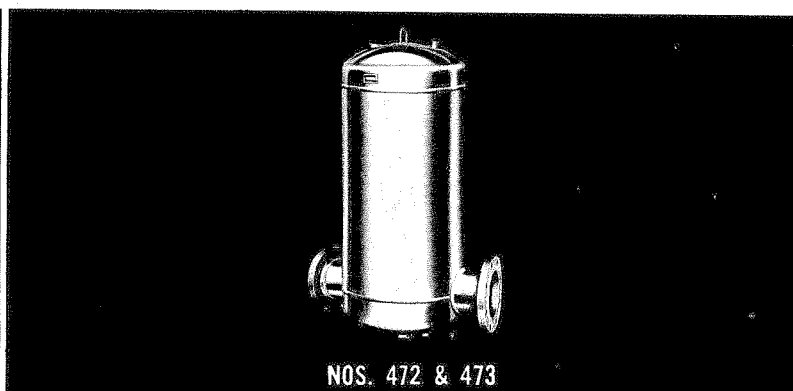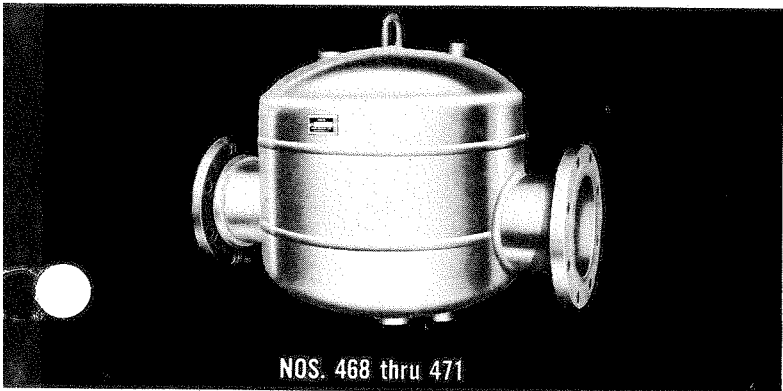

SPECIFICATIONS

Shell Heads and Flanges — ASA & ASME constructed for 150 PSI working pressure.
Maximum Operating Temperature

375°F.

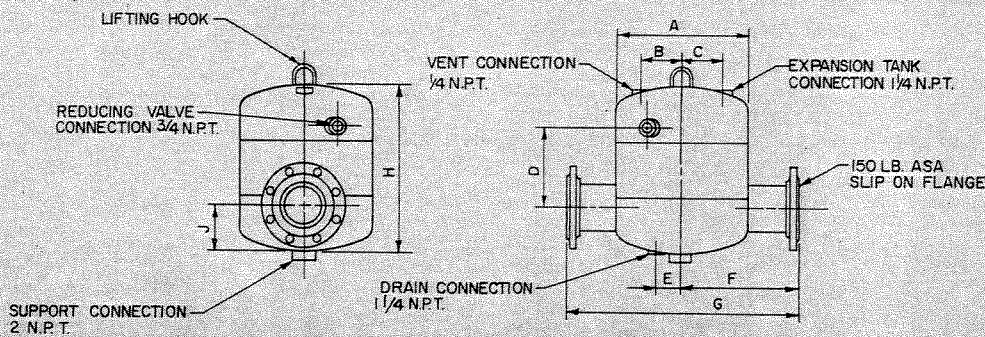

PROD. NO.	PIPE SIZE	RECOMMEND FLOW GPM	A	B	C	D	E	F	G	H	J	APROX. WHT. LBS.
468	3"	120	12¾"	4"	4"	5"	3"	11"	22"	15"	4½"	108
469	4"	230	14"	4½"	4½"	5"	3"	12"	24"	18"	5"	150
470	5"	400	16"	5"	5"	5½"	3"	13"	26"	20"	5½"	180
471	6"	660	20"	5¾"	5¾"	6¾"	4"	15"	30"	20"	7¾"	254
472	8"	1100	20"	7½"	7½"	23"	4½"	17½"	35"	48"	8½"	540
473	10"	1800	20"	7½"	7½"	23"	4½"	17½"	35"	48"	8½"	600

Taco Heaters of Canada, Ltd.
85 Queen Elizabeth Blvd.
Toronto 18, Canada

T A C O . I N C . 1160 Cranston Street, Cranston, Rhode Island 02909